



## AGGREGATE PROPERTIES

REPORT TO: **A&K**  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

PROJECT: **A&K 2018 Misc. Testing**  
 PROJECT NO.: **9400.044**  
 LOCATION: **Fallon, NV**  
 LAB NO.: **CC-2285-18**

SAMPLED BY: **Others** DATE: **10/8/2018**

MATERIAL DESCRIPTION: **Type 2 Class B Aggregate Base** COLOR: **Brown**

SAMPLE LOCATION: **Lambert - US HWY 95 Pit**

U.S. Std. Sieve Size	Percent Passing		SSPWC 200.01.03-I
3"			
2"			
1"	100		100
3/4"	97		90-100
1/2"	86		
3/8"	77		
#4	58		35-65
#8	45		
#10	42		
#16	35		15-40
#30	28		
#40	24		
#50	20		
#100	13		
#200	7.9		2-10

SPECS

SPECS

NATURAL MOISTURE	4.0%				FRACTURED FACES	53%	35 MIN
R-VALUE	82	70 MIN			L.A.R.	19%	45 MAX
LIQUID LIMIT	NV	35 MAX					
PLASTICITY INDEX	NP	8 MAX					

D-1140 Soak Time:       N/A        
 ( ) Specification Limits

Respectively Submitted by:

**\* Out of Standard Specification**

Report Status: Original or Amended


and Reviewed by:

9222 Prototype Drive  
 Reno, NV 89521  
 Tel 775.827.6111  
 Fax 775.827.6402

800 East College Parkway  
 Carson City, NV 89706  
 Tel 775.883.7077  
 Fax 775.883.7114

178 South Maine Street  
 Fallon, NV 89406  
 Tel 775.423.2188  
 Fax 775.423.5657

225 Kingsbury Grade, Suite A  
 Stateline, NV 89449  
 Tel 775.588.6490  
 Fax 775.588.6479

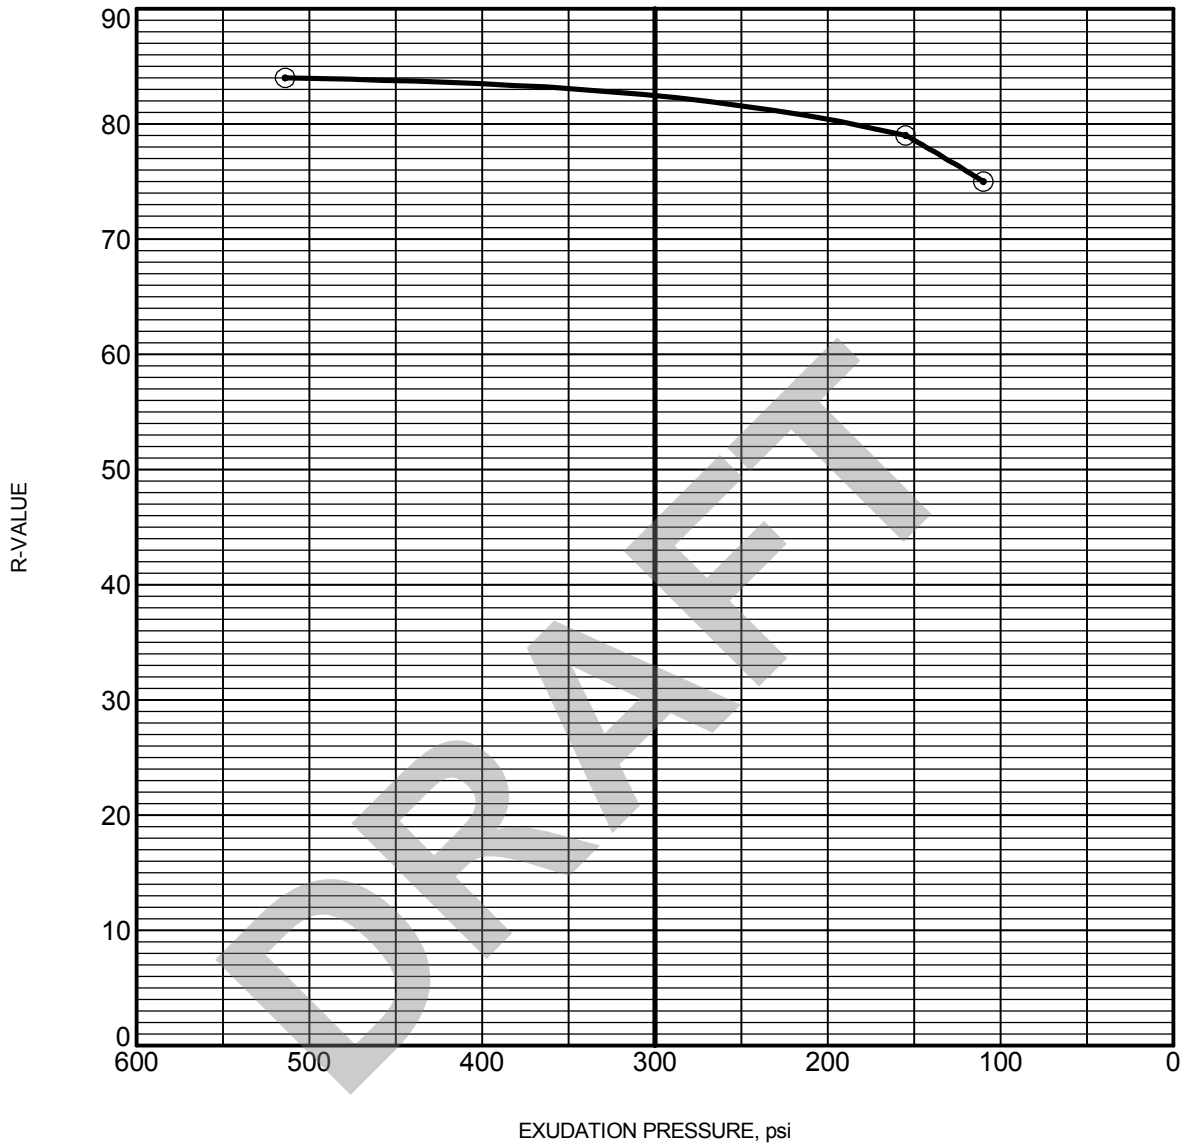

**Test Data**

Specimen No.	Water Content (%)	Dry Density (pcf)	Expansion (psf)	Exudation (psi)	Test R-Value*
1	10.7	125.1	0.0	110.0	75.0
2	9.8	128.5	0.0	155.0	79.0
3	8.7	127.3	0.0	514.0	84.0

\* Reported values have been corrected for sample height, where required.

**Test Result**

Specimen Identification	Classification	R-Value
CC-2285-18      0.0	Lambert - US HWY 95 Pit	82

R-VALUE 9400.044.GPJ US LAB.GDT 10/12/18



**Lumos & Associate**  
 800 E. College PKWY  
 Carson City, NV  
 (775) 883-7077  
 Fax: (775) 883 7114  
 pmccreary@lumosinc.com

A&K Earth Movers 2018 Misc. Testing  
**RESISTANCE VALUE TEST**

Job Number: 9400.044

Date: October 2018

**PLATE**  
  
**A-1**